Testing of Fire Resistance and Smoke Resistant Assemblies




Rich Walke UL Codes and Advisory Services

UL and the UL logo are Trademarks of UL © 2018

August 15, 2018


Fire-Resistance-Rated Construction

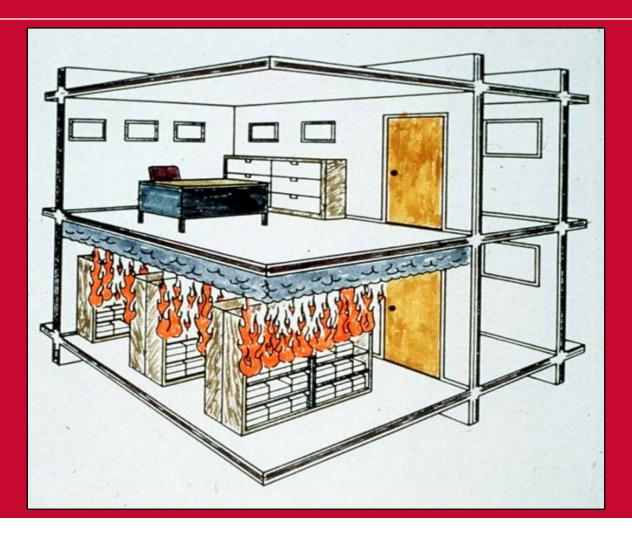



Fire-Resistance-Rated Construction

Code Requirements for **Fire-Resistance-**Rated Construction

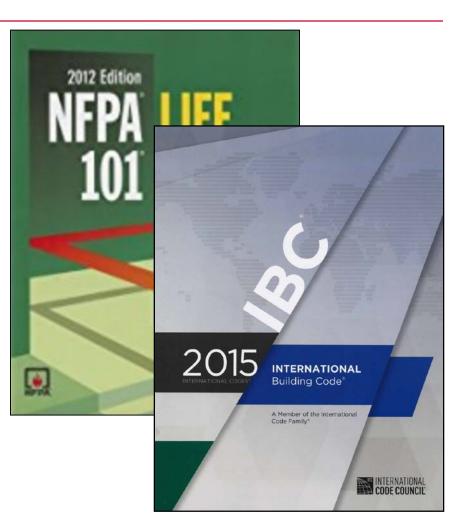



Code Requirements

- IBC Section 703.2 Fire-resistance ratings shall be determined in accordance with ANSI/UL 263 or ASTM E119
- LSC 8.2.3.1 The fire resistance of structural elements and building assemblies shall be determined in accordance with test procedures set forth in ANSI/UL 263 or ASTM E119



Fire Resistance

- Expressed as an Hourly Time Period
- Ratings range from 1/2 to 4 hours
- Containment of Fire to Room or Floor of Origin





Fire-Resistance-Rated Construction

Establishing Fire-Resistance Ratings





Standards

- ANSI/UL 263
- ASTM E119
- NFPA 251 (Withdrawn)




Building Components

- Columns
- Beams
- Floor/Ceilings or Roof/Ceilings
- Walls




Time - Temperature Curve

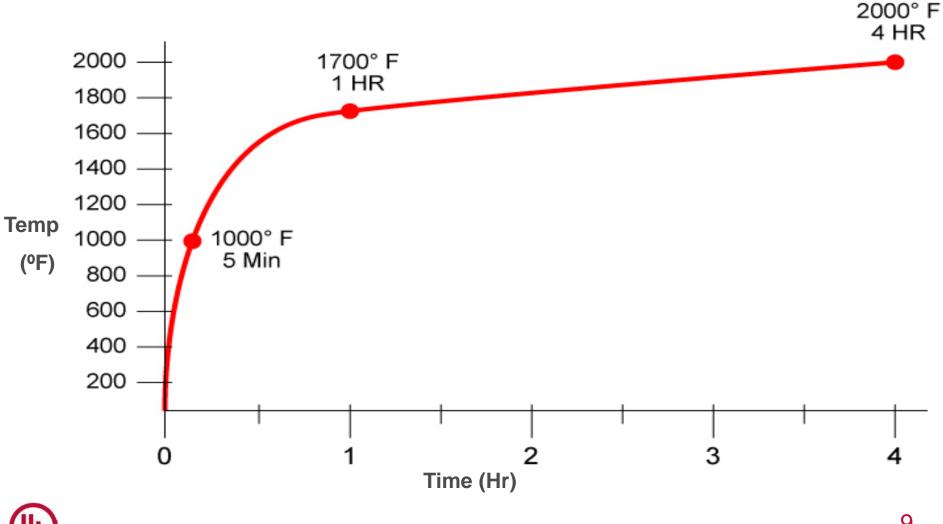


Floor/Ceiling or Roof/Ceilings


- Sample size 180 sq ft / 12 ft
- Load applied Per design

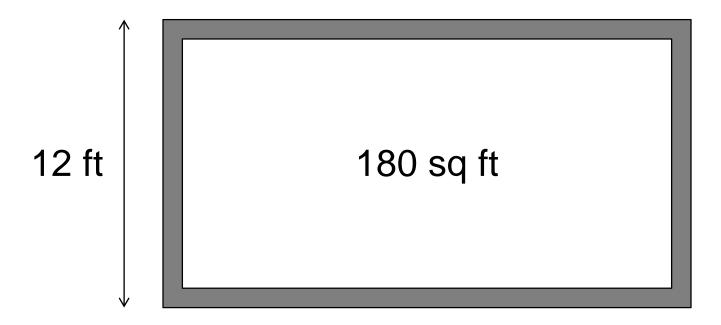



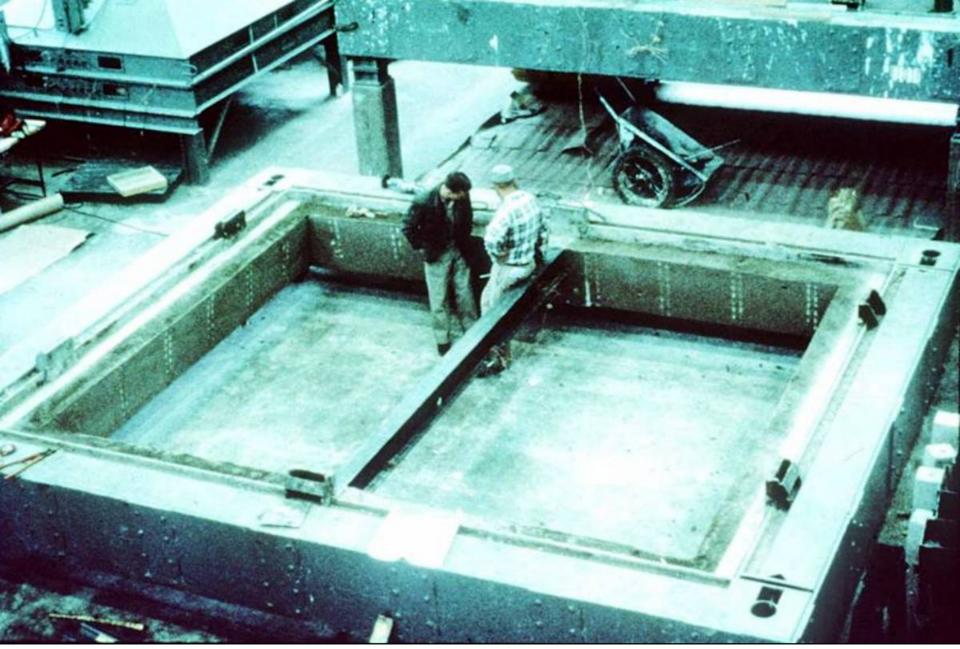



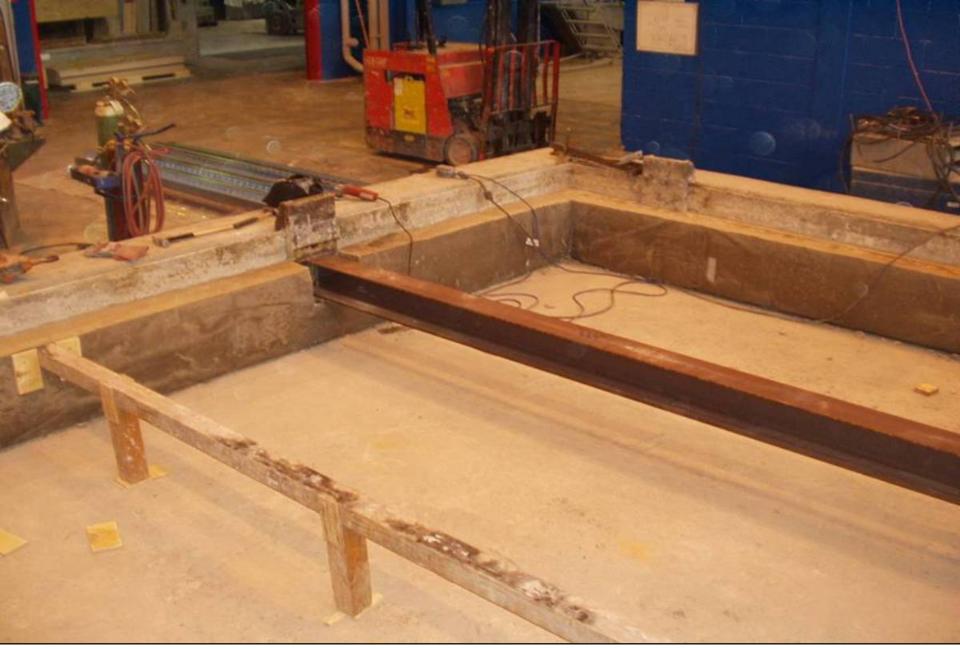










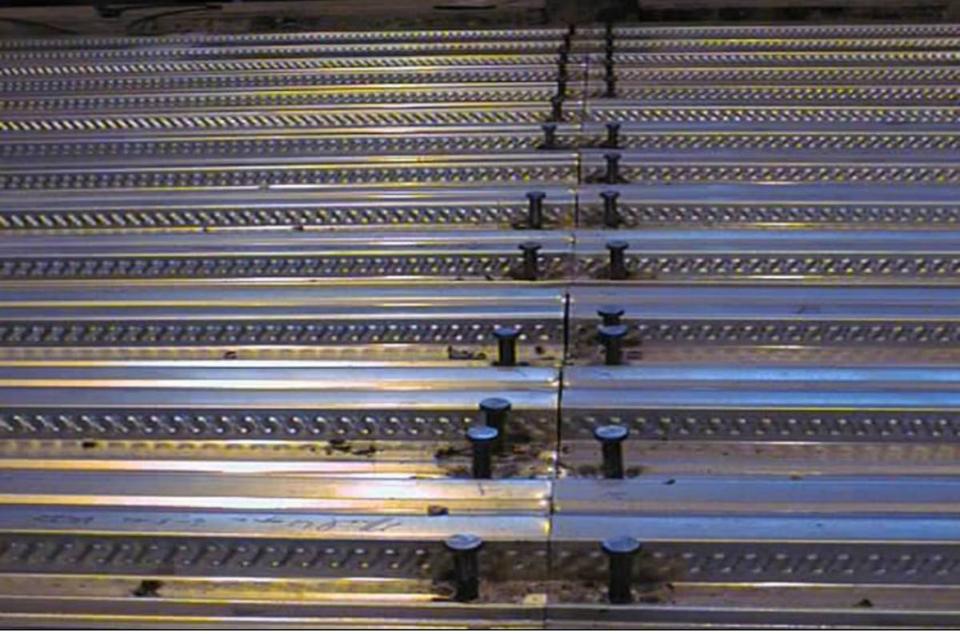


























Conditions of Acceptance Floor/Ceilings or Roof/Ceilings


- Support load
- Flame passage
- 250°F / 325°F
- Support temperatures

Walls

- Sample size 100 sq ft / 9 ft
- Load applied Per design

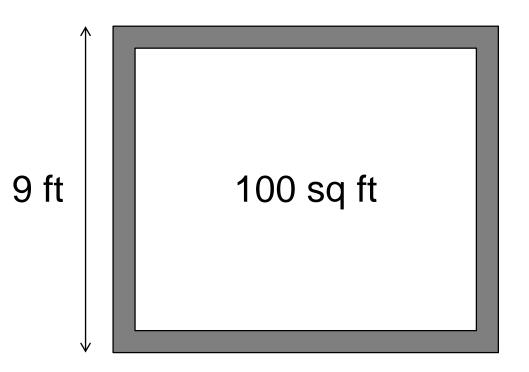



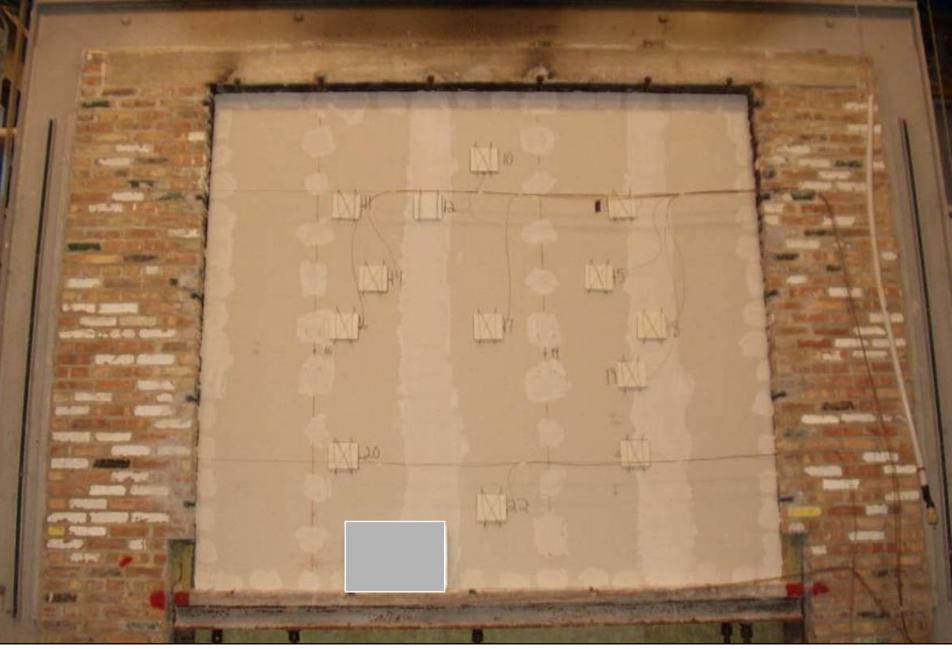





















Conditions of Acceptance – Walls

- Flame passage
- 250°F / 325°F
- Support load
- Hose stream

Where are the Listings Found?

Hard Copy

U

Fire Resistance Directory Volume 1


2015

With Hourly Ratings for Beams, Floors, Roofs, Columns, Walls and Partitions

Certifications in effect as of April 8, 2015

Online



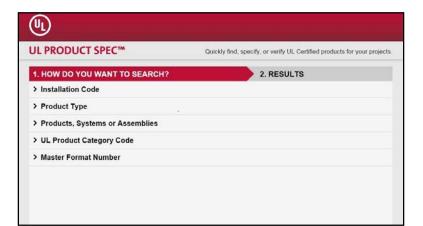

Questions / Comments





Breaches in Fire-Resistance-Rated Construction

- Penetrations
- Joint Systems
- Opening Protectives
- Ducts and Air Transfer Openings



Breaches in Fire-Resistance-Rated Construction Cont.

Do breaches really impact the performance of a fire-resistance-rated assembly?

Absolutely!!!



Breaches in Fire-Resistance-Rated Construction Cont.

- Unsealed or improperly sealed breaches cost lives and property!
 - MGM Grand, Las Vegas, NV Fire confined to 1st floor.
 Eighty-four fatalities, most on upper floors.
 - Hilton Hotel, Las Vegas, NV Fire spread from 8th to 23rd floor in 25 minutes at exterior of building. Eight fatalities.
 - First Interstate Bank, Los Angeles, CA Fire spread from 12th to 16th floor through improperly protected penetrations and through unprotected perimeter joint. One fatality.
 - One Meridian Plaza, Philadelphia, PA Fire spread from 22nd to 30th floor through improperly protected penetrations and through perimeter joint. Three fatalities.



IBC Requirements

- IBC Breaches shall be protected
 - Section 714 Penetrations
 - Section 715 Fire-Resistant Joint Systems
 - Section 716 Opening Protectives
 - Section 717 Ducts and Air Transfer Openings



LSC Requirements

- LSC Breaches shall be protected
 - Penetrations
 - Joint Systems
 - Opening Protectives
 - Ducts and Air Transfer Openings





- Each type of breach has a unique fire test standard associated with it which compliments ANSI/UL 263 and ASTM E119
- Where breach occurs in, through or between assemblies intended to restrict the movement of smoke, the code also sets limits on the leakage through the breach




Questions / Comments





Firestop Systems


Code Requirements for Penetrations of Smoke Resistant Construction

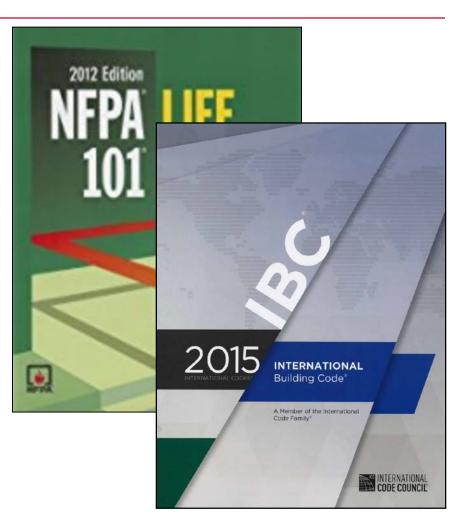



Firestop Systems

- Three elements
 - Floor or Wall Assembly
 - Penetrating Item
 - Firestopping Products
- Tested in accordance with ANSI/UL 1479

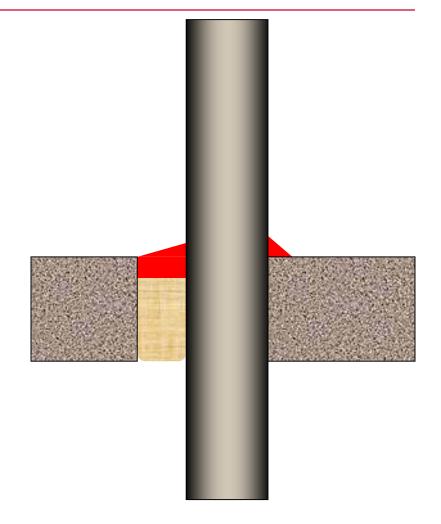



Ratings

- F Flame Occurrence
- T Heat Transmission
- L Leakage (Optional)
- W Water Leakage (Optional)



Code Requirements

- IBC 714.4.4 Penetrations in smoke barriers shall have an L Rating at ambient and 400°F
 - Max 5.0 CFM / sq ft of opening for each system, or
 - •Cumulative 50 CFM for all systems in any 100 sq ft of barrier
- LSC 8.5.6.2 Penetrations shall be protected by a system or material capable of restricting the transfer of smoke



Firestop Systems

Establishing Leakage Ratings






- L Rating methodology added to ANSI/UL 1479 in 1993
- Leakage determined at 0.3 in. WC
- Tested at Ambient and 400°F
- Results published in either CFM or CFM per sq ft








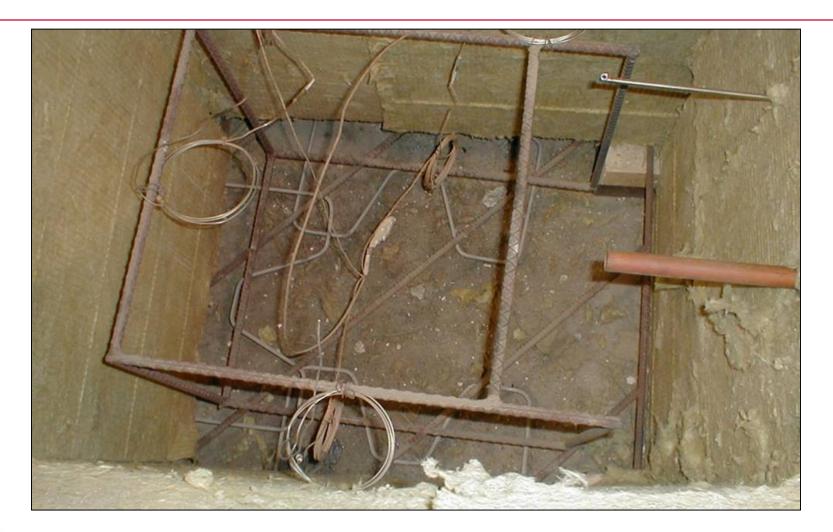







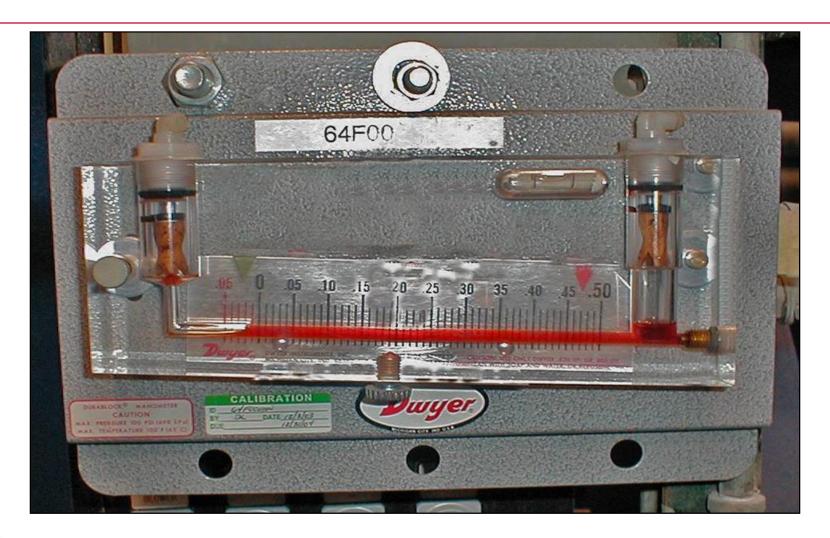



Test Procedure

- Incidental chamber leakage determined using blank slab
- Air leakage of test sample determined at ambient temperature
- Air leakage of test sample determine at 400°F
- Incidental chamber leakage rechecked after cooling



Test Procedure Cont.

- Firestop system assigned L Rating at ambient and 400°F, by subtracting incidental chamber leakage from test sample leakage
- L Ratings of firestop systems published in UL Fire Resistance Directory along with F and T Ratings



Where are the Listings Found?

Hard Copy

U

Fire Resistance Directory Volume 1

2015

With Hourly Ratings for Beams, Floors, Roofs, Columns, Walls and Partitions

Certifications in effect as of April 8, 2015

Online



(
UL PRODUCT SPEC™	Quickly find, specify, or verify UL Certified products for your projects.
1. HOW DO YOU WANT TO SEARCH?	2. RESULTS
> Installation Code	
> Product Type	
> Products, Systems or Assemblies	
> UL Product Category Code	
> Master Format Number	




Questions / Comments





Fire Resistive Construction

UL's Online Search Tools

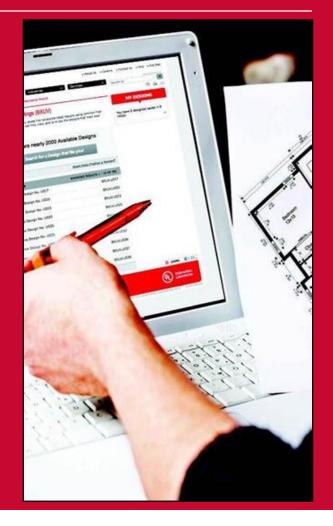



UL's Online Search Tools

- Online Certifications Directory
- Product Spec
- Code Link



Online Certifications Directory

- Helps you achieve code compliance
- Is continuously updated
- Needs no password
- Is free no charge for use
- www.ul.com/database



Product Spec

- Helps identify designs meeting project parameters
- Needs no password
- Is free no charge for use
- Covers everything discussed at this symposium
- www.ul.com/productspec





Code Link

- Correlates model code sections to UL product categories
- Covers many model codes and editions (IBC, IFC, NEC, etc.)
- Flexible search capabilities
- Powerful tool to locate appropriate Listings
- www.ul.com/codelink



Questions / Comments





Thank You for Attending!!!

Rich Walke Codes and Advisory Services Department Underwriters Laboratories 750 Anthony Trail Northbrook, IL 60062 Richard.N.Walke@UL.com (847) 664-3084

www.ul.com

