Barrier Management Symposium ASHE, The Joint Commission

ASHE Region 6 Kahler Hotel

2015 April 14 & 15

he Joint Commission

ASHE



Barrier Management Symposium

- Speakers Tuesday & Wednesday
 - Jonathan Flannery, ASHE Advocacy
 - Anne Guglielmo, The Joint Commission
 - Rich Walke, UL
 - Bill Koffel, Koffel Associates
 - Nestor Sanchez, USG Corp.
 - Rich Walke, UL Concrete Industry
 - Bill McHugh, FCIA Firestopping
 - Paul Baillargeon, DHI Fire Doors
 - Marc Sorge, Greenheck Fire&Smoke Dampers
 - Tim Warren, TGP Fire Rated Glazing

Details

- Objective YOU
- Thanks for Attending...
- Speakers Volunteer...

Objective – Share Knowledge

- Barriers are for Safety DIIM
 - Properly *Designed* and Specified
 - Tested and Listed Systems Directories, Tables
 - Specified
 - Professional *Installation* Companies
 - Properly *Inspected* Commissioned, by Companies
 - Maintained
 - NFPA 101 2000 (TJC, CMS)
 - International Fire Code IFC 2012 Annually (Local)
- Effective Compartmentation for Fire & Life Safety

"TOTAL FIRE PROTECTION"

- Effective Compartmentation
 - Fire Barriers, Fire Walls/Floors, Smoke Barriers
 - Firestopping, Fire Dampers, Swinging and Rolling Fire Doors, Fire Rated Glazing
- Detection & Alarm Systems
- Sprinkler Suppression Systems
- Education & Egress-
 - Building Owners & Managers, Building Occupants and Firefighters









Building & Fire Code Requirements

- Continuous Fire Resistance
 - Walls / Horizontal Assemblies Continuity
 - Firestop Products Become Firestop Systems
 - Penetrations
 - Joints Head /Bottom of Wall Perimeter Joints
 - Fire & Smoke Damper Duct Systems
 - Fire Doors and Hardware Systems
 - Rolling & Swinging
 - Fire Rated Glazing

Continuity

Effective Compartmentation Features











Barrier Continuity SYSTEMS

- Products Become Systems Through Testing
 - Fire & Smoke Barriers ASTM E 119, UL 263
 - Firestopping ASTM E 814 / UL 1479, ULC-S-115, UL 2079, E-2307 as the test method..."
 - **F/S Dampers** UL 555, UL 555S
 - Swing/Rolling Fire Doors UL 10B, 10C
 - Fire Rated Glazing UL 9
 - SYSTEM Testing = Suitability statement for use of a product in a specific *system* application



Products become Systems Hose Stream = Shock Test






Barrier Continuity Products become SYSTEMS


- Fire Rated Systems Directories
 - UL Fire Resistance Directory
 - Intertek
 - FM Approvals

Systems Selection & Analysis...Not as easy as it looks...






Barrier Continuity I – Installation – Listed Systems

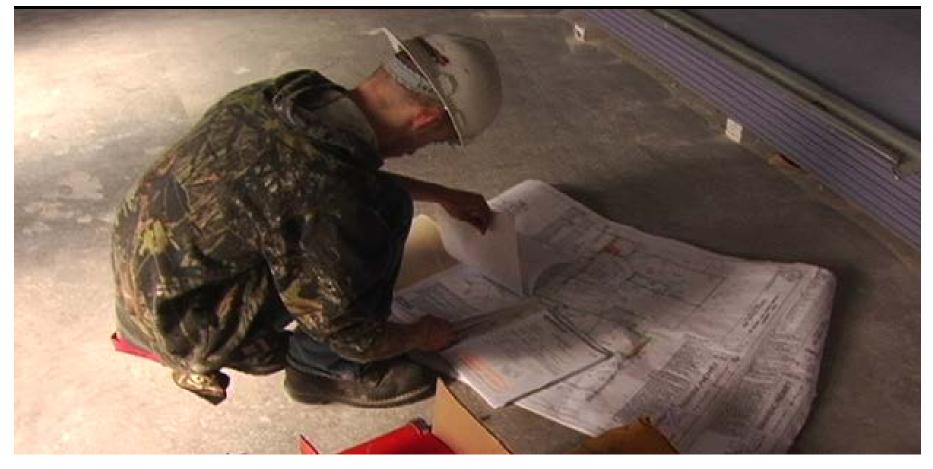

I- Installation Who's Responsible, How to Choose???

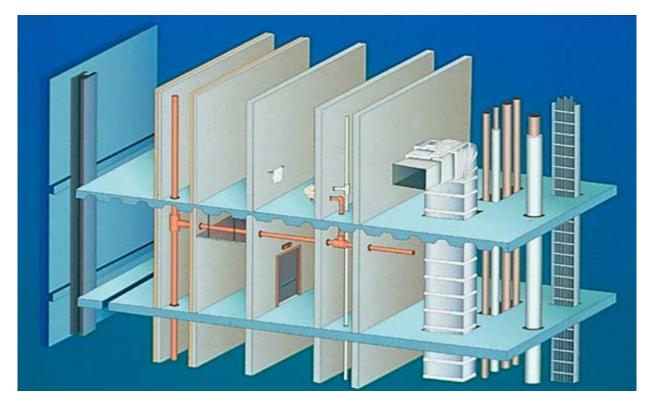

Graphics – STI

What Contractor Qualifications?


- FM 4991 Standard for the Approval of Firestop Contractors
- UL Qualified Firestop Contractors
- Other Industries...
 - FM 4991/UL CONTRACTORS UNDERSTAND SYSTEMS & DOCUMENTATION

Why Contractor Qualifications?

- Accountability
- Built right the first time...
- Documentation
- SYSTEMS Selection, Analysis, As-Builts
 - F, T, L, W Rated Systems
 - Tolerances Annular Space Sizes, Angles
 - Gap Sizes Undercuts Framing
 - Anchors Spacing Hardware
 - Closers Activation Sensors, more...




Installation & Inspection

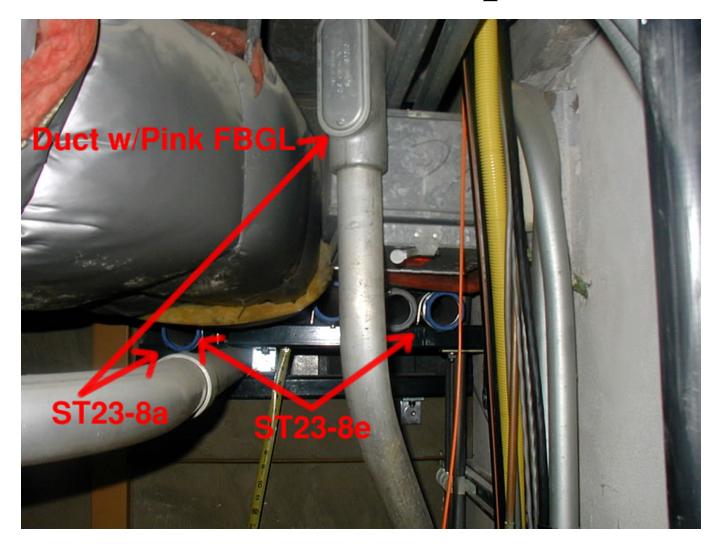


I – Inspection – Options

- Contractor Self Inspection
 - Verify Management System validity
- Manufacturer Inspection?
 - Does not exist ... Survey, maybe
- Special Inspection/Commissioning
 - Independent 3rd Party
 - Destructive, Non Destructive
 - Specified Frequency
 - Inspection Agency Accreditation IAS AC 291

Compartmentation for Safety

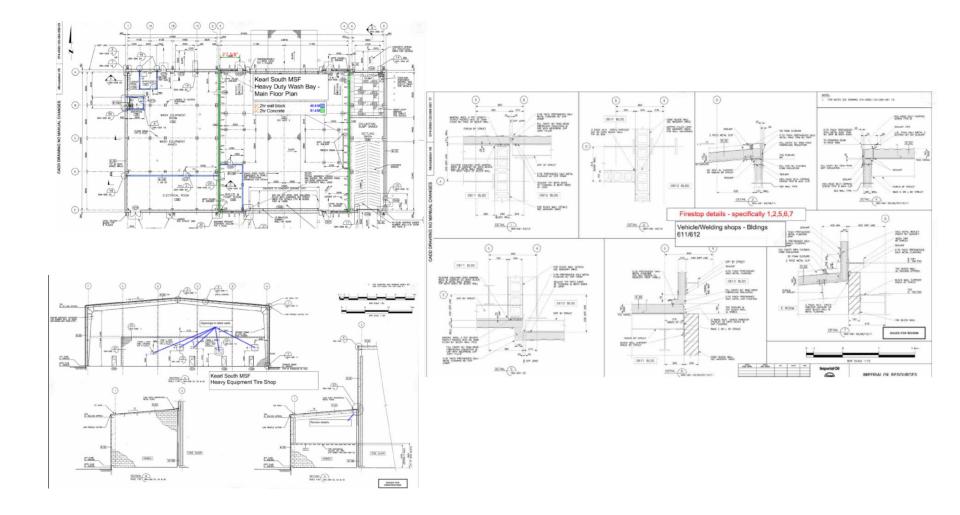

M – Maintenance (& Management)

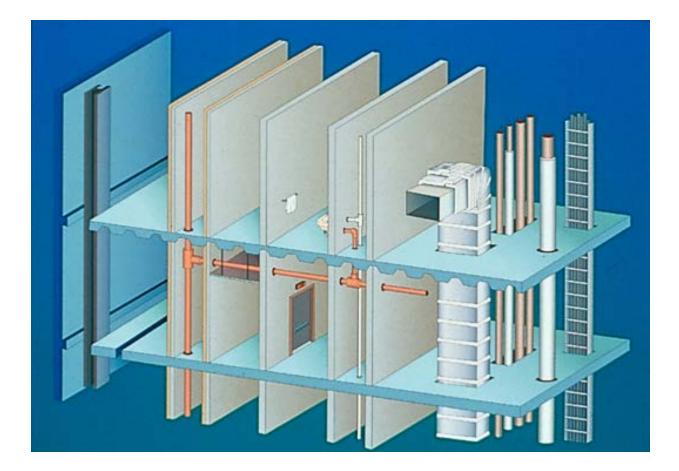

Firestop Maintenance

• Maintenance

- Code Required
- How??
- How to keep Track Barrier Management Initiative
 - Paper
 - Software
 - Labeling



National Fire Protection Association - NFPA 101-2012

• SECTION 4.5.8 Maintenance, Inspection, and Testing.

4.5.8.1 Whenever or wherever any device, equipment, system, condition, arrangement, level of protection, fire-resistive construction, or any other feature is required for compliance with the provisions of this Code, such device, equipment, system, condition, arrangement, level of protection, fire-resistive construction, or other feature shall thereafter be continuously maintained in accordance with applicable NFPA requirements or requirements developed as part of a performance-based design, or as directed by the AHJ. [101:4.6.12.1]

National Fire Protection

Association - NFPA 101-2012

- 4.5.8.2 No existing life safety feature <u>shall be removed or</u> <u>reduced</u> where such feature is a requirement for new construction. [101:4.6.12.2]
- 4.5.8.3* Existing life safety features obvious to the public, if not required by the Code, *shall be either maintained or removed*. [101:4.6.12.3]
- 4.5.8.4 Any device, equipment, system, condition, arrangement, level of protection, fire-resistive construction, or any other feature requiring periodic testing, inspection, or operation to ensure its maintenance <u>shall be tested, inspected, or operated</u> as specified elsewhere in this Code or as directed by the AHJ. [101:4.6.12.4]
- **4.5.8.5 Maintenance, inspection, and testing** <u>shall be performed</u> <u>under the supervision of a responsible person who shall</u> <u>ensure</u> that testing, inspection, and maintenance <u>are made at</u> <u>specified intervals</u> in accordance with applicable NFPA standards or as directed by the AHJ. [101:4.6.12.5]

International Fire Code Maintenance

SECTION 703 FIRE-RESISTANCE-RATED CONSTRUCTION



703.1 Maintenance. The required fire resistance rating of fireresistance rated construction (including walls, fire stops, shaft enclosures, partitions, smoke barriers, floors, fire resistive coatings and sprayed fire resistant materials applied to structural members and fire resistive joint systems) <u>shall be maintained</u>. Such elements shall be <u>visually inspected by the owner annually</u> and properly repaired, restored or replaced when damaged, altered, breached or penetrated.

Openings made therein for the passage of pipes, electrical conduit, wires, ducts, air transfer openings, **and holes** made for any reason **shall be protected with approved methods** capable of resisting the passage of smoke and fire.

UAE Fire and Life Safety Code of Practice Maintenance & Management

Chapter 1, SECTION 21 Firestopping

<u>21.15.2</u> The required fire resistance rating of installed firestop systems shall be visually inspected by the owner or owner's inspection agency annually. Damaged, altered or breached firestop systems shall be properly repaired, restored or replaced to comply with applicable codes as per the guidelines of Civil defense.

<u>21.15.3</u> Any new **Openings** made therein for the passage of through penetrants, **shall be protected with approved firestop system** to comply with applicable codes as per the guidelines of Civil defense.

National Fire Code of Canada

National Fire Code of Canada

- Division B Part 2, Building and Occupant Fire Safety
 2.2.1.2 Damage to Fire Separations where fire separations are damaged so as to affect their integrity, they shall be repaired so that the integrity of the fire separation is maintained...
- FCIA Manual of Practice Appendix, Maintenance
 FCIA recommends Barrier Management for Effective Compartmentation and Structural Protection




M-Barrier Management Systems

'When you're up to you're a___in alligators, it's hard to remember you're there to drain the swamp.'



Barrier Management Begins when new construction ends...

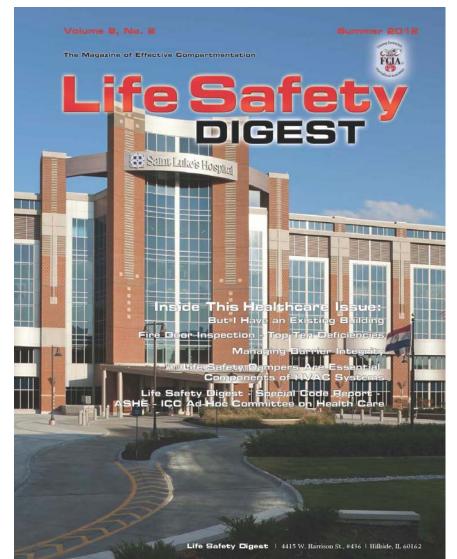


M–Barrier Management Systems

- NEW Buildings 07-84-00 Specs
 - SYSTEMS Expectations
 - As Built SYSTEMS
 - SYSTEMS from Testing Labs
 - Installation to SYSTEMS
 - Inspection to SYSTEMS
- AS BUILT DOCUMENTATION REQ'D


M–Barrier Management Systems


• Now it's your building....

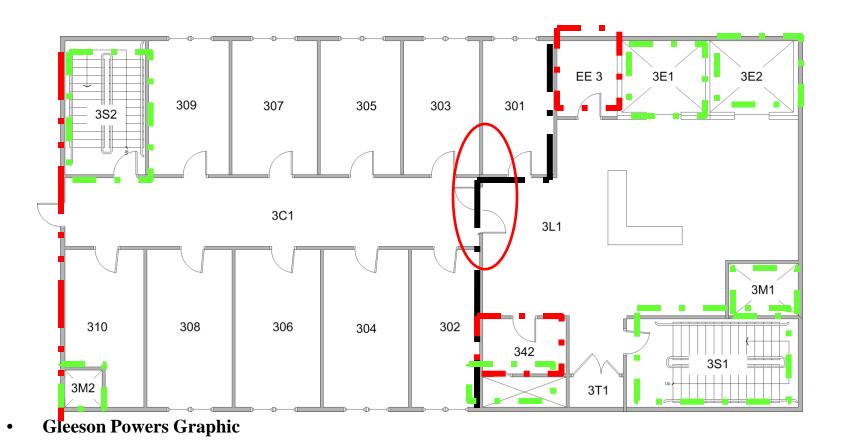

WHAT NEEDS TO BE MAINTAINED?

- Fire Resistive Wall Construction
- Fire Doors
- Fire Dampers
- Firestop Systems:
- Joint Systems
- Hot and Cold Water Piping
- Laboratory Waste
- Medigas Piping
- Pneumatic Tubing
- Sprinkler Piping
- Rigid Electrical Conduits
- Cable Trays
- BX Cables
- Low Voltage Cables
- and More....
 - Low Voltage!!!!



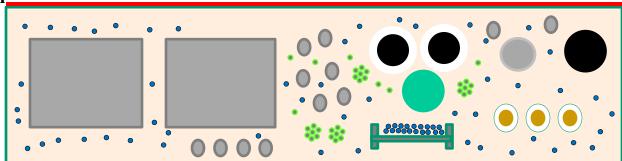

M–Barrier Management Systems

- Barrier Management
 - TJC #1 & 2 Violations
 - Constant issues
 - Control?
 - Staff?
 - Attitude?



Barrier Management HUB

- A HUB must control all Action
 - C-Suite Execs
 - Construction In House & Outside
 - I-T Department In House & Outside
- The HUB is YOU!

Why Barrier Hub is YOU?

- YOU answer to...
 - The Joint Commission
 - CMS Inspectors
 - Building Official, Fire Marshal
 - Other AHJ's
 - C-Suite
 - Staff
 - Patients

M–Barrier Management Systems

- Barrier Management Policy Tool
- ASHE Member Healthcare Engineer & Director Communicates...
 - In House Construction & I-T Crews
 - Outside Contractors

Barrier Management Policy = Tool

- ASHE Member Healthcare Engineer & Director Communicates...
 - Rules of Engagement in Contracts
 - Internal Contracts
 - External Contracts
 - Pre Construction Meetings
 - Barrier Warnings Markings
 - Violation Consequences
 - Ongoing Management
 - Staff Education & Incentives





Barrier Management Policy Tool – Rules of Engagement in Contracts

- Internal Contracts -
 - In House Departments similar to Outside Contractors
- External Contracts
 - AIA Contract
 - Marked Fire Smoke Barrier Actions
 - Barrier Permits
 - Documentation
 - Report

- Methods to Control
 - Paper, Pictures & Files
 - Electronic Pictures & Files
 - 'Custom'
 - 'Packages'


- Common Elements
 - Life Safety Drawings
 - Existing Conditions Documented
 - Ongoing Survey Records
 - Deficiency Reports
 - Systems Documentation Control, Retrieval

- Document & Control
- Fire Resistance Rated & Smoke Resistant
 - Barrier Walls, Floors
 - Firestop Systems Penetrations & Joints
 - Fire Doors Rolling & Swinging
 - Fire Rated Glazing
 - Fire/Smoke, Combination Dampers

- Electronic Best Practice Elements
 - Action Oriented
 - Projects Specifications
 - Ongoing Surveys FCIA RPPS 2010-1
 - Action Reminders
 - In Process Status
 - Record Retrieval



Sample Permit – Area

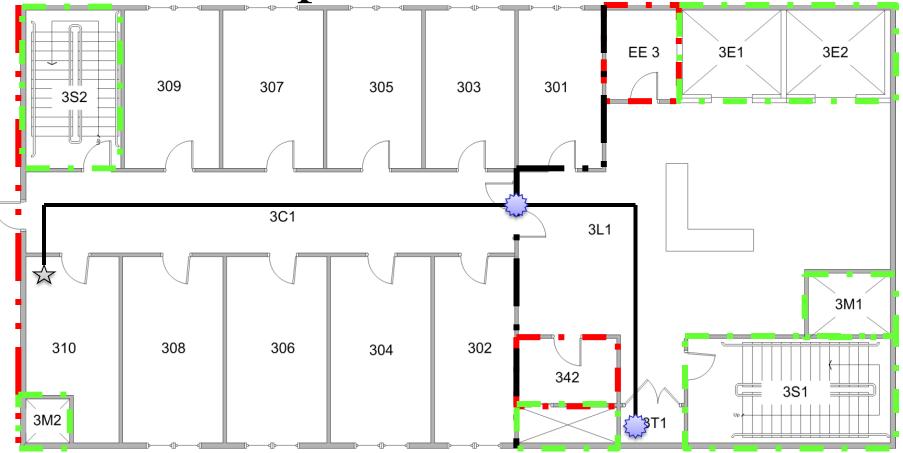

		J		📌 Demo H	Hospital	Peri	mit No.: 2	011-005		
re	a (*): 3C1	1/3L1				Side 1: 3C1			Side 2: 3L	.1
l	SR ID: LST	-B1-03-007					(Compliance S	Status: 😑 No	on-compliant
Sur	vey ID:							LSR 0	Group:	
fe	Safety Detai	Is Surveys Ph	notos Floor	Plan Diagrams						
	LSR Deta	Status	Latest Ph	Detail Description	Life Safety T	Life Safety Sub	Letters	Numbers	LSR Count	Notes
>	001	Non-com	- 7	Firestopping Through Wall Penetration - Firestop	Firestopping	Through Wall Pe	WL	1000-1999	1	
	002	Compliant		Firestopping Through Wall Penetration - Firestop	Firestopping	Through Wall Pe	WL	1000-1999	0	
	003	Compliant	1985- C	Firestopping Through Wall Penetration - Firestop	Firestopping	Through Wall Pe	WL	5000-5999	1	
	004	Compliant		Firestopping Through Wall Penetration - Firestop	Firestopping	Through Wall Pe	WL	3000-3999	1	EZ Path
<				III)	>
	Add New Lif	e Safety Detail	Entry	Edit Selected Life Safe	ety Detail Entry					
E	dit	Save Sa	ve & Add An	other Save & Close	e Delete Rec	ord				Cancel

fe Safety Type Firestopping		Life Si	afety Sub Type: Th	rough Wall Penetra	tion - Firestop Systems			
Penetration Type: EMT or Conduit		Penetration Size: Max 1"			Annular Space: MIN: 0 to .50", MAX:			
Wall Rating Type:								
Date Completed: May-02-2011	Classifi	ed System:		Survey #: Survey		Survey Date:		
Deficiency Description: No firestopping			Suggested C	A Notes: Instal	UL Listed Firestopping S	System at penetration/joint		
Survey Notes:			CA Notes:					
	oto			Su	irvey Photo			
Corrective Action Photo	Side: 37296	Photo ID: 37296	Corrective	Action Photo	sid	e: 2: 3L1 Photo ID: 37297		
Side: 4:304	127-10		Side		GP Glosson Powers, Int. Protect LOT Prestop Systems - Do Not Disturt U. System s Mar 1222 Data 3-22 Valance Valant T.C.	-10		
Side: 1: 3C1 Photo	Notes:		Side:	2: 3L1	Photo Notes			
Photo ID: 37298			Photo ID:					

- Pre Construction Meetings Education
 - Barrier Markings Mean...
 - Actions when at Barriers Required...
 - Permit required Above Ceiling, Barrier Hole...
 - Infection Control Rules
 - Healthcare facility Rules

Barrier Management Policy Tool – Barrier Warnings on ASSEMBLIES – International Building Code – 2009++





703.7 Marking and identification. *Fire walls, fire barriers, fire partitions, smoke barriers and smoke partitions or any* other wall required to have protected openings or penetrations shall be effectively and permanently identified with signs or stenciling. Such identification shall:

1. Be located in accessible concealed floor, floor-ceiling or attic spaces;

2. Be located within 15 feet (4572 mm) of the end of each wall and at intervals not exceeding 30 feet (9144 mm) measured horizontally along the wall or partition; and

3. Include lettering **not less than 3 inches (76 mm) in height with a minimum 3/8 inch (9.5 mm) stroke** in a contrasting color incorporating the suggested wording.

"FIRE AND/OR SMOKE BARRIER—PROTECT ALL OPENINGS" or other wording

or other wording.

Exception: Walls in Group R-2 occupancies that do

not have a removable decorative ceiling allowing access to the concealed space.







- Violation Consequences
 - In House
 - 2 strikes & work reassignment to cleaning...
 - Others...
 - Outside Contractors
 - 2 strikes & not allowed to work above ceilings
 - Others...

- Incentives
 - Find Violators....
 - Staff Awards

- Ongoing Management
 - Engineering Staff Reviews
 - User Staff Reviews
 - Inside Construction
 - Outside Contractor

- Education Healthcare Staff Simple??
 - Fire Doors & Hardware Simple things…
 - Close & Latch
 - Holes in Door
 - Ladder = ?? Permit Sticker?
 - Fire Rated Walls Holes
 - Accidental
 - Workers

"TOTAL FIRE PROTECTION"

- Effective Compartmentation
 - Fire Barriers, Fire Walls/Floors, Smoke Barriers
 - Firestopping, Fire Dampers, Swinging and Rolling Fire Doors, Fire Rated Glazing
- Detection & Alarm Systems
- Sprinkler Suppression Systems
- Education & Egress–
 - Building Owners & Managers, Building Occupants and Firefighters









"DIIM"

- Barriers are for Safety DIIM
 - Properly *Designed* and Specified
 Tested and Listed Systems Directories,
 - Professional *Installation* Companies
 - Properly *Inspected* Commissioned
 - *Maintained* Annually IFC 2012, NFPA 101, International Fire Code

Effective Compartmentation is a SYSTEM







New UL test standards for Life Safety Dampers will take effect in July 2002







Barrier Management Symposium

- Speakers Tuesday
 - Jonathan Flannery, ASHE Advocacy
 - Anne Guglielmo, The Joint Commission
 - Rich Walke, UL
 - Bill Koffel, Koffel Associates
 - Nestor Sanchez, USG Corp.
 - Rich Walke, UL, Concrete Industry

Barrier Management Symposium

- Wednesday- Features in 'Barriers'
 - Bill McHugh, FCIA Penetrations
 - Paul Baillargeon, DHI Fire Doors
 - Marc Sorge, Greenheck Fire & Smoke Dampers
 - Tim Warren, Fire Rated Glazing
 - Bill McHugh & Anne Guglielmo- Barrier Management
 - Closing Remarks Jonathan Flannery, Bill McHugh



Contacts

Firestop Contractors International Association Hillside, IL – +1-708-202-1108 - office Bill McHugh – bill @ fcia.org

Barrier Management Symposium ASHE, The Joint Commission

ASHE Region 6 Kahler Hotel

2015 April 14 & 15

he Joint Commission

ASHE

